

Sewage Ejector Installation Plan


Heckscher Property

#137 & 139 Main St. Tisbury Map 6C Lots 30 & 30.1

Prepared By Cooper Environmental Services, LLC

March 28, 2011

Not to Scale

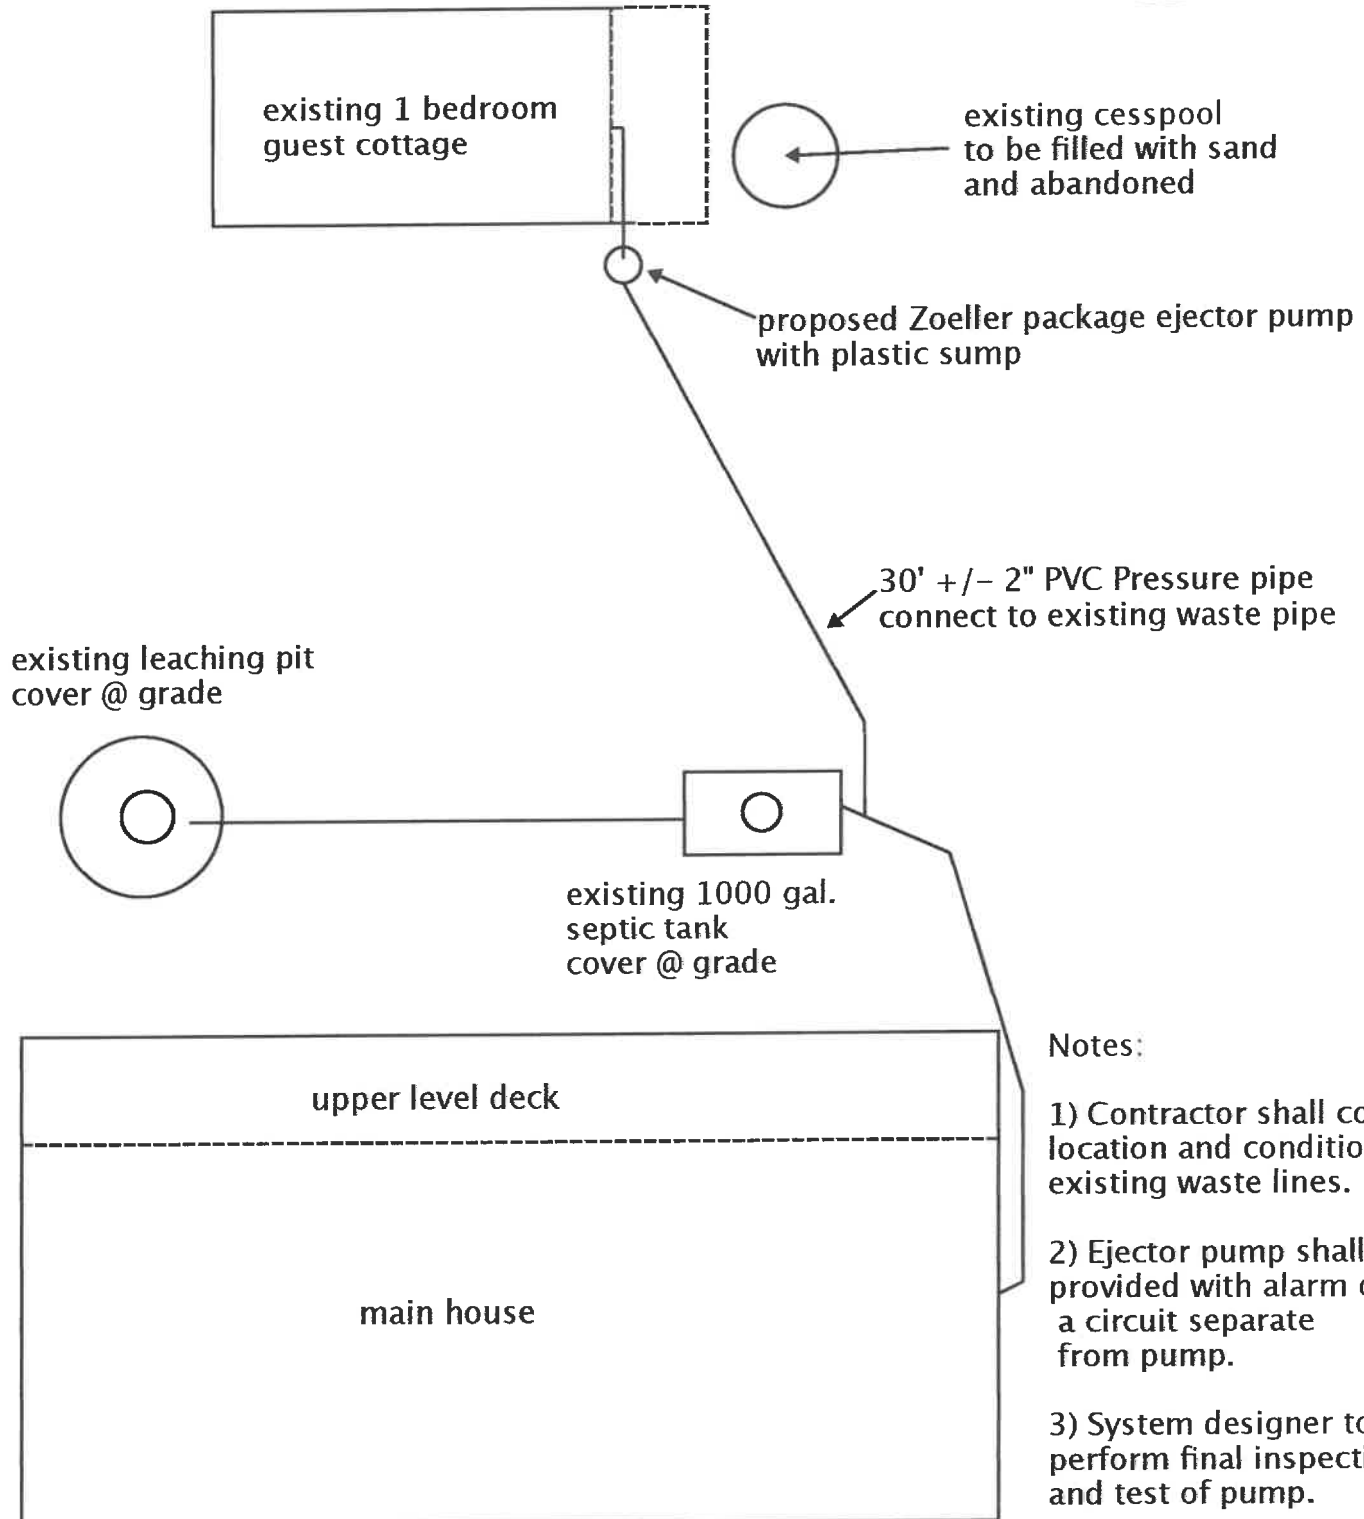

Notes:

- 1) Contractor shall confirm location and condition of existing waste lines.
- 2) Ejector pump shall be provided with alarm on a circuit separate from pump.
- 3) System designer to perform final inspection and test of pump.